


SANITARY SEWER SERVICE: CUSTOMER PORTION

N.T.S.

NOTES:

1. ALL CONNECTIONS SHALL BE GASKETED.
2. TRACER WIRE SHALL BE MADE CONTINUOUS FROM THE CLEANOUT TO THE BASEMENT OR CRAWL SPACE. CUSTOMER TO CONNECT TO TRACING WIRE AT THE POINT OF CONNECTION NEAR THE CLEANOUT.
3. MAINTENANCE OF THE SEWER SERVICE FROM THE RIGHT-OF-WAY TO AND INCLUDING THE INTERNAL PLUMBING ON PREMISES, AND ITS USE, MUST ALWAYS BE KEPT IN FULL COMPLIANCE. THE FOREGOING REMAINS THE SOLE RESPONSIBILITY OF THE SEWER CUSTOMER.
4. THE CUSTOMER MUST SUBMIT A COMPLETED SEWER CONNECTION APPLICATION, OBTAIN TOWN APPROVAL TO PROCEED AND SCHEDULE INSPECTIONS BY THE TOWN PRIOR TO BACKFILLING OR PLACING THE CUSTOMER PORTION INTO USE.
5. A LARGER DIAMETER SERVICE LINE MAY BE REQUIRED WHERE DISTANCE OR CONSUMER DEMAND ARE A FACTOR.
6. CUSTOMER SHALL INSTALL CLEANOUTS, PER DETAIL S-06, AT 100' INTERVALS AS REQUIRED.
7. REFER TO MATERIAL LIST, S-03.

ISSUE DATE: JUNE 2015		TOWN OF BATAVIA
REVISIONS	DATE	COMMENTS
		SANITARY SEWER DETAILS SANITARY SEWER SERVICE: CUSTOMER PORTION
		DRAWING S-04C

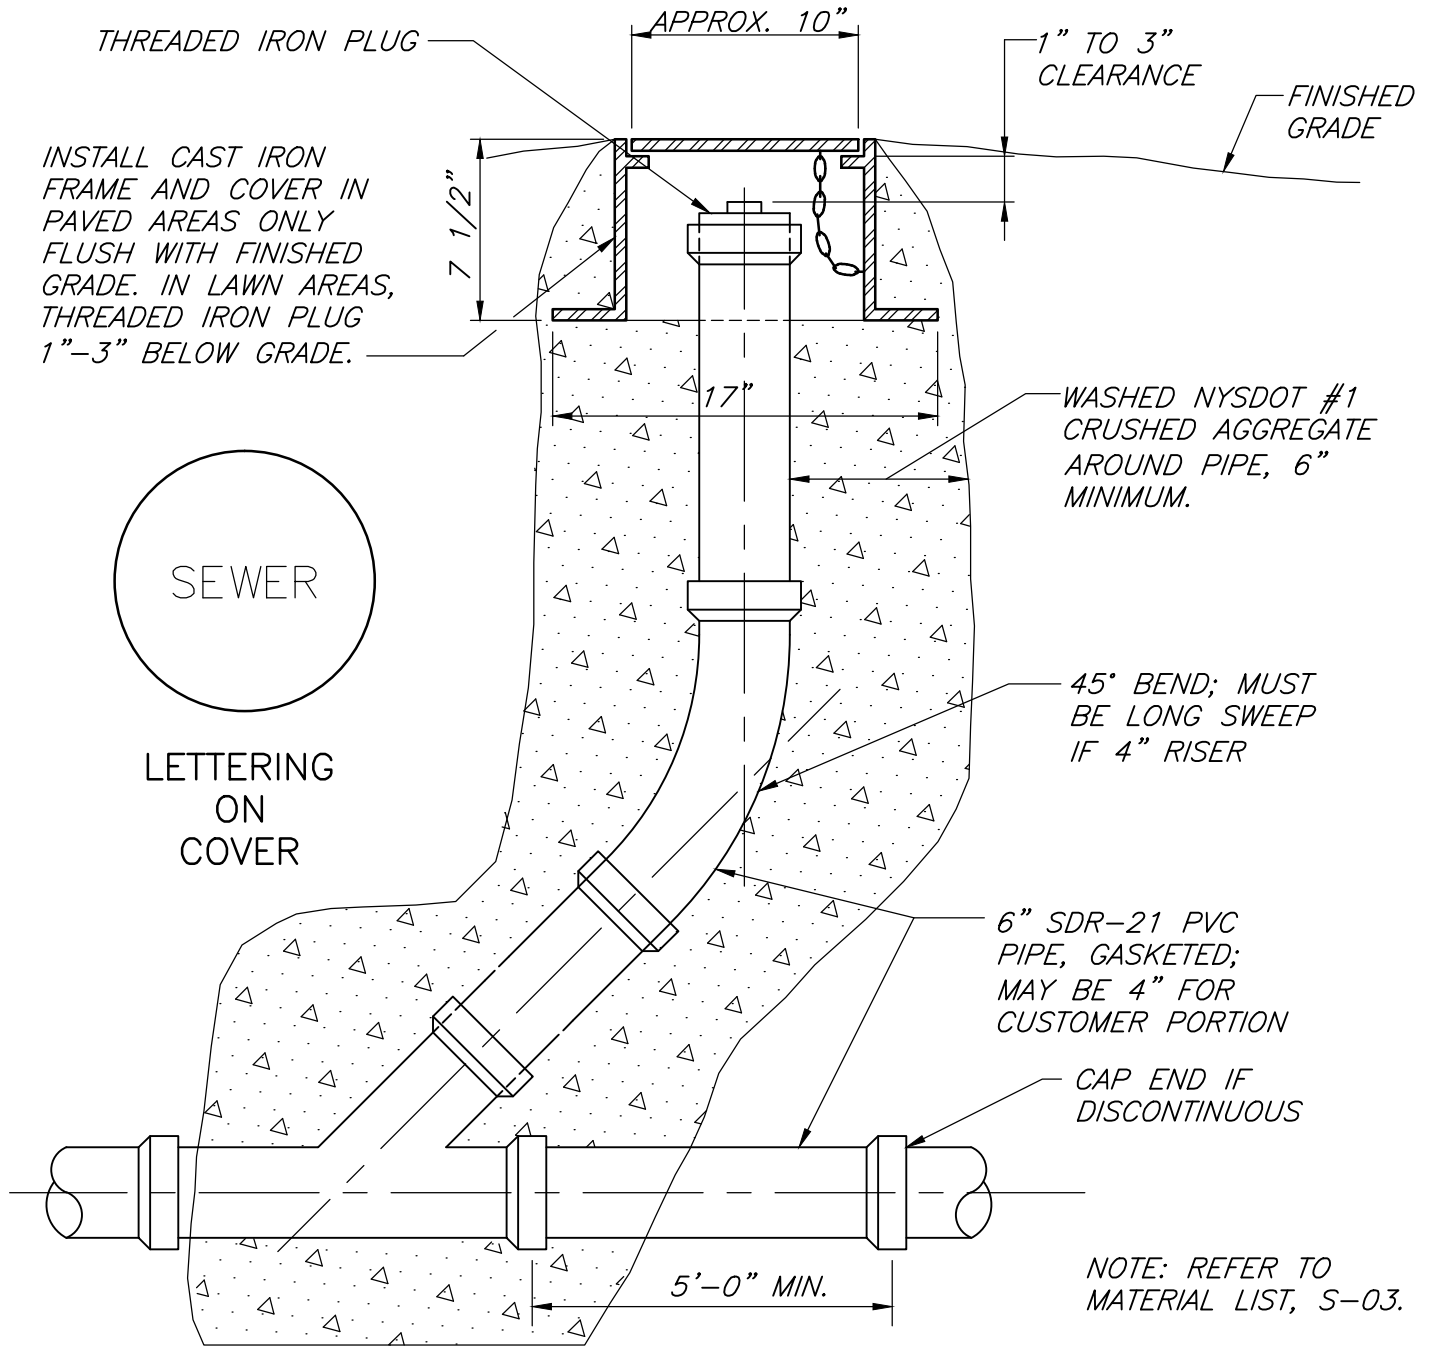

TYPICAL SANITARY CLEAN-OUT

N.T.S.

ISSUE DATE: JUNE 2015

TOWN OF BATAVIA

SANITARY SEWER DETAILS

TYPICAL SANITARY
CLEANOUT

DRAWING S-06

REVISIONS

DATE

COMMENTS

DATE	COMMENTS

REVISIONS				
DATE	DESCRIPTION	BY	CHKD	APPD

ISSUE DATE: JUNE 2015

STANDARD MATERIAL LIST			
DESCRIPTION	ALTERNATIVE 1 MAKE/MODEL/MATERIAL	ALTERNATE 2 MAKE/MODEL/MATERIAL	COMMENTS
SEWER MAINS	MIN. THICKNESS SDR-21 PVC, GASKETED		
SEWER FORCE MAIN	HDPE DR-11 WHEN DIRECT BURY, OTHERWISE DR-9 FOR DRILLED		
CLEANOUT FRAME AND COVER	SYRACUSE NO. 4155 CAST IRON FRAME AND COVER	NEENAH NO. 1975-A CAST IRON FRAME AND COVER	FOR USE IN PAVED AREAS, COVER LABELED "SEWER"
SEWER MAIN DETECTABLE WARNING TAPE	LINEGUARD III 5 MIL DETECTABLE WARNING TAPE, 3" WIDE	PROPAK INDUSTRIES 5 MIL DETECTABLE WARNING TAPE, 3" WIDE	GREEN IN COLOR LABELED "BURIED SEWER PIPE"
TRACER WIRE	10-GAUGE, STRANDED COPPER, INSULATED TRACER WIRE	COPPERHEAD 12-GAUGE, SOLID STEEL CORE, COPPER PLATED, INSULATED TRACER WIRE	GREEN IN COLOR
CONNECTION TO SEWER MAIN	INSERTA TEE	GASKETED CUT IN WYE	
HDPE TO PVC CONNECTION	EBBA IRON SERIES 1500 RESTRAINT	ROMAC SERIES 600 RESTRAINTS	
FILTER FABRIC - AIR RELEASE MH	MIRAFI 140N	TYPAR STYLE 3341	
PIPE SUPPORT - AIR RELEASE MH	STANDON MODEL S92	PIPELINE PRODUCTS MODEL PSG-106S	BOLTS AND STRAPS SHALL BE STAINLESS STEEL
AIR RELEASE VALVE	GA INDUSTRIES FIGURE 925	GA INDUSTRIES IS TOWN STANDARD, NO ALTERNATIVE AIR RELEASE ACCEPTED	AIR RELEASE VALVE SIZE TO BE DETERMINED BASED ON CONDITIONS, 1/2" AND 1" BALL VALVES (3 VALVES TOTAL) SHALL BE INCLUDED FOR FUTURE MAINTENANCE
MANUAL AIR RELEASE CONNECTION COVER	FORD METER PIT DOUBLE LID WITH CAST IRON COVER (3W)	MUELLER H-10814 PIT DOUBLE WITH CAST IRON COVER	SET ON KISTNER GRADE RING PB-18-S OR EQUAL GRADE RING
MANUAL AIR RELEASE CURB BOX	MUELLER MARK II ARCH STYLE CURB BOX WITH STAINLESS STEEL ROD H10308 OR H10310 MARKED "SEWER"	FORD CURB BOX MEDL EA 2-50-60-42R WITH S/S ROD AND CB-7 CURB BOX BASE)IF REQUIRED), LID MARKED "SEWER"	
TEES, WYES, BENDS	AMERICAN MADE DUCTILE IRON - CEMENT LINED	ANY AMERICAN MANUFACTURER	

TOWN OF BATAVIA
SANITARY SEWER DETAILS

STANDARD
MATERIAL LIST

DRAWING S-03A

